



DOW CORNING / SSI - XJS

XJS STANDARD DRAWING FOR ACP OVERLAYS

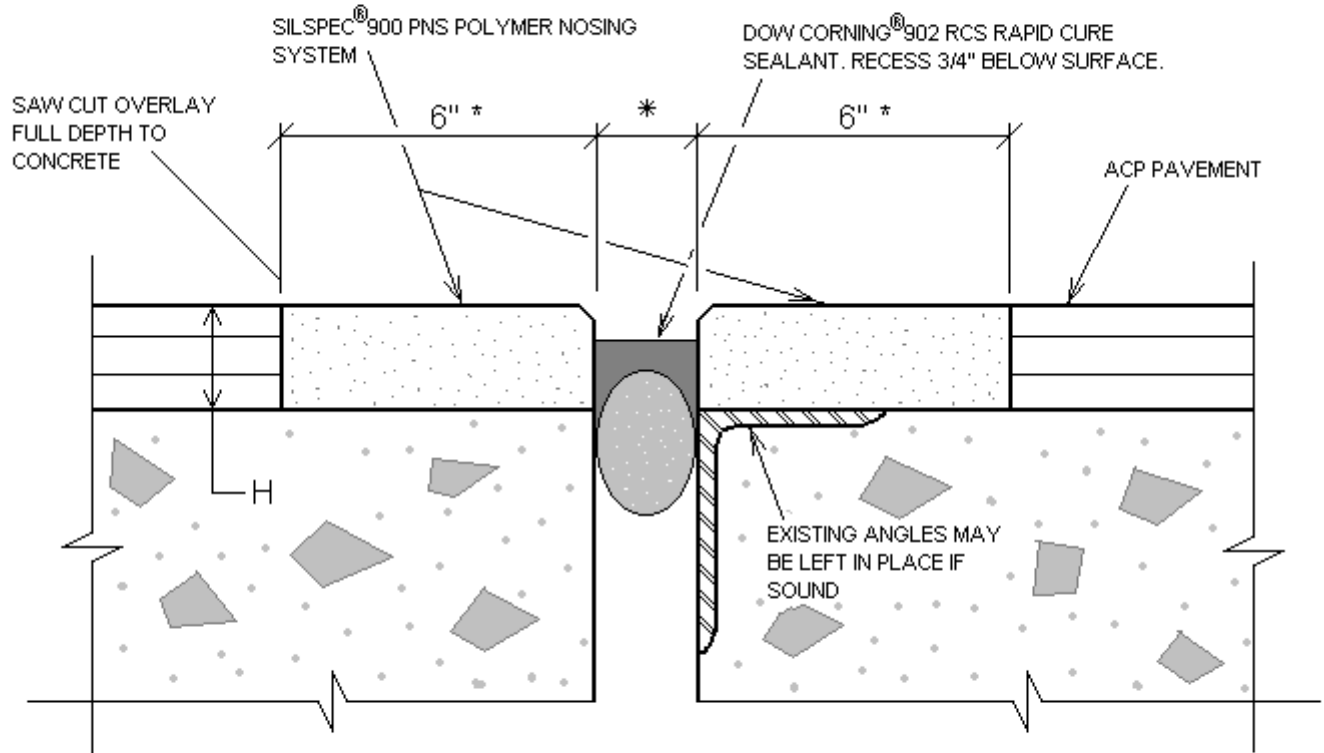

CONSTRUCTION NOTES:

- 1) SAW ACP OVERLAY FULL DEPTH A MIN. 6" BACK FROM THE JOINT FACE.
- 2) REMOVE ACP OVERLAY AND CLEAN BLOCK-OUT PER MANUFACTURERS PUBLISHED PROCEDURES.
- 3) INSTALL SILSPEC 900 POLYMER NOSING.
- 4) SEAL NEW JOINT WITH DOW CORNING 902 RCS SEALANT FOLLOWING RECOMMENDED PROCEDURES.
- 5) A REPRESENTATIVE OF THE MANUFACTURER SHALL BE PRESENT AT THE START OF WORK TO DEMONSTRATE PROPER CLEANING AND INSTALLATION TECHNIQUES.



NOTE:
EDGES OF SILSPEC 900 PNS SHALL BE GROUND TO 3/8" X 3/8" BEVEL.

H = DEPTH OF ACP OVERLAY

* = MINIMUM WIDTH OF NOSING SHALL BE 6", IF THE OVERLAY EXCEEDS 3" IN DEPTH, THE INSTALLER SHALL USE A 2 TO 1 WIDTH TO DEPTH RATIO.

* = WIDTH OF JOINT OPENING, OPENING IN NOSING SHALL MATCH EXISTING JOINT OPENING, UNLESS DIRECTED OTHERWISE BY PROJECT ENGINEER.

SSI Construction & Industrial Materials
P.O. Box 50009
Tulsa, OK. 74150
(918)587-5567

TITLE: STANDARD FOR ACP OVERLAYS	
DATE: 3/22/2011	DRW#: 1 OF 1
PROJECT:	
CONTRACTOR:	
ssi.highway@ssicm.com	DRAWING NOT TO SCALE