

SILSPEC® SES STRIP SEAL RETROFIT INSTALLATION DETAILS

Typical Installation Detail for 6.56' (2m) Sticks– SES112 Through SES400 (1½" - 4")

For Reel Sizes See: Typical Installation Detail for 12' Reels– For SES012 Through SES114 (½" - 1¼")


FIELD INJECTED SILICONE BANDS



FIELD-APPLIED EPOXY ADHESIVE BONDER



FACTORY APPLIED AND CURED SILICONE BELOWS FACING

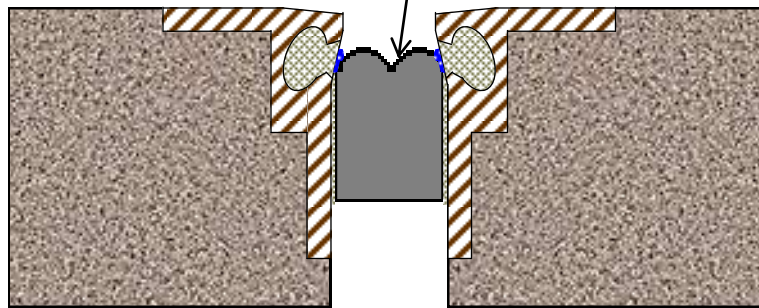

STEEL STRIP SEAL JOINTS

NOTES:

1. REMOVE EXISTING SEAL FROM JOINT OPENING AND CHANNELS.
2. SANDBLAST STEEL FACES AND CHANNEL TO REMOVE RUSTING AND CORROSION.
3. READ AND UNDERSTAND INSTALLATION INSTRUCTIONS PRIOR TO STARTING INSTALLATION.
4. APPLY EPOXY ADHESIVE TO JOINT FACE AND FILL CHANNELS AS SHOWN ON DRAWING.
5. SILSPEC® SES SEAL SHOULD BE RECESSED 1/2" INTO JOINT OPENING FOR REEL SIZES, 3/4" FOR 6.56' (2m) SIZES.

Silicone Specialties, Inc.
P.O. Box 50009
Tulsa OK. 74150
(800)888-8909
www.ssicm.com



SILSPEC® SES STRIP SEAL RETROFIT

6/11/2016

Drawing 1 of 1

2m Sticks– SES112 Through SES400 (1½" - 4")